
# **Safety Technique**

# SAFEMASTER Safety Module For Safety Switches LG 5925/920






# **Function Diagram**

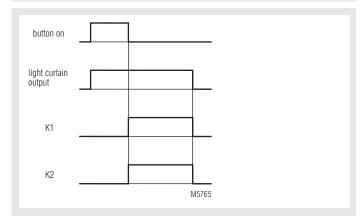

### **Block Diagram**

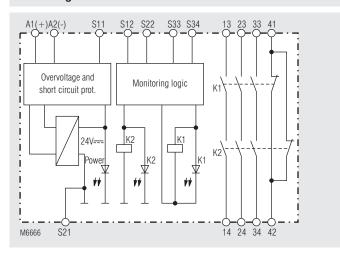

#### · According to

- Performance Level (PL) e and category 4 to EN ISO 13849-1: 2008
- SIL Claimed Level (SIL CL) 3 to IEC/EN 62061
- Safety Integrity Level (SIL) 3 to IEC/EN 61508
- to connect:
  - safety switch NE 5020
- safety switch NE 5021
- Output: max. 4 NO contacts, see contacts
- 1- or 2-channel operation
- Line fault detection on On-button
- Manual restart or automatic restart, switch S2
- · with or without cross fault monitoring switch S1
- LED indicator for state of operation
- LED indicator for channel 1 and 2
- Wire connection: also 2 x 1.5 mm<sup>2</sup> stranded ferruled, or 2 x 2.5 mm<sup>2</sup> solid DIN 46 228-1/-2/-3/-4
- As option with plugable terminal blocks for easy exchange of devices
  - with screw terminals
  - or with cage clamp terminals
- Width 22.5 mm

## **Approvals and Marking**



#### **Applications**

Protection of people and machines

· Monitoring of safety gates

### Indicators

upper LED: on, when supply connected lower LEDs: on, when relay K1 and K2 energized


## Notes


Line fault detection on On-button:

The line fault detection is only active when S12 and S22 are switched simultaneously. If The On-button is closed before S12, S22 is connected to voltage (also when line fault across On-Button), the output contacts will not close. A line fault across the On-button which occurred after activation of the relay, will be detected with the next activation and the output contacts will not close.

ATTENTION! If a line fault occurs after the voltage has been connected to S12, S22, the unit will be activated because this line fault is similar to the normal On-function.


#### **Circuit Diagrams**





LG 5925.04/920

LG 5925.48/920



LG 5925.02/920

A1 (+)

A2 (-)

41,42

S12, S22, S34

S11, S21, S33

**Connection Terminals** 

13, 14, 23, 24, 33, 34, 43, 44

**Unit Programming** 

Terminal designation

#### Input

**Technical Data** 

Nominal voltage U<sub>N</sub>: DC 24 V  $0.9 \dots 1.1 \; \text{U}_{\text{\tiny N}}$  DC approx.  $1.7 \; \text{W}$ Voltage range: Nominal consumption: Min. Off-time: 250 ms

Control voltage on S11 at U,: DC 22.5 V

Control current /typ.)

over S12 or S22: 35 mA at U,

Min. voltage between terminals S12, S22

when relay activated: DC 19 V Internal PTC Short-circuit protection: Overvoltage protection: Internal VDR

#### Output

Contacts

LG 5925.02/920: 2 NO contacts LG 5925.04/920: 4 NO contacts

LG 5925.48/920: 3 NO contacts, 1 NC contact

The NO contacts are safety contacts.

ATTENTION! The NC contacts 41-42 can only be used for monitoring

Operate delay typ. at U<sub>N</sub>:

. Manual start: 20 ms Automtic start: 350 ms

Release delay typ. at U,:

Disconnecting the supply: 20 ms Disconnecting S12, S22: 15 ms Contact type:

forcibly guided Nominal output voltage:

AC 250 V

DC: see limit curve for arc-free operation Thermal current I,:

max. 8 A per contact see current limit curve

Switching capacity

to AC 15:

3 A / AC 230 V IEC/EN 60 947-5-1 NO contacts: NC contacts: 2 A / AC 230 V IEC/EN 60 947-5-1 to DC 13:

NO contacts: 2 A / DC 24 V IEC/EN 60 947-5-1 IEC/EN 60 947-5-1 NC contacts: 2 A / DC 24 V

**Electrical life** 

at 5 A, AC 230 V  $\cos \varphi = 1$ : > 2.2 x 105 switching cycles

Permissible operating

max. 1 200 switching cycles / h frequency:


Short circuit strength max. fuse rating: IEC/EN 60 947-5-1 10 A gL

line circuit breaker: B 6 A

Mechanical life: > 20 x 10<sup>6</sup> switching cycles

#### **General Data**





Drawing shows setting at the state of delivery

Signal designation

Forcibly guided NO contacts for

Forcibly guided indicator output

+ / L

- / N

Inputs

Outputs

release circuit

Continuous operation Operating mode:

Temperature range

operation: - 15 ... + 55 °C storage: - 40 ... + 85 °C < 2.000 m altitude:

Clearance and creepage

distances

rated impuls voltage /

pollution degree: 4 kV / 2 (basis insulation) IEC 60 664-1

**EMC** 

Electrostatic discharge: IEC/EN 61 000-4-2 8 kV (air) HF-irradiation: 10 V / m IEC/EN 61 000-4-3 Fast transients: 2 kV IEC/EN 61 000-4-4

Surge voltages

between

2

0.5 kV wires for power supply: IEC/EN 61 000-4-5 between wire and ground: 2 kV IEC/EN 61 000-4-5 Interference suppression: Limit value class B EN 55 011

Degree of protection

Vibration resistance:

IP 40 IFC/FN 60 529 Housina: Terminals: IP 20 IEC/EN 60 529

Housing: Thermoplastic with V0 behaviour

according to UL subject 94 Amplitude 0.35 mm IEC/EN 60 068-2-6 frequency 10 ... 55 Hz

Climate resistance: 15 / 055 / 04 IEC/EN 60 068-1

14.03.14 en / 425

#### **Technical Data**

Terminal designation: EN 50 005

Wire connection

Screw terminals

(integrated): 1 x 4 mm<sup>2</sup> solid or

1 x 2.5 mm<sup>2</sup> stranded ferruled or 2 x 1.5 mm<sup>2</sup> stranded ferruled or

DIN 46 228-1/-2/-3/-4

2 x 2.5 mm<sup>2</sup> solid

Insulation of wires

or sleeve length: 8 mm

Plugin with screw terminals

max. cross section

for connection: 1 x 2.5 mm<sup>2</sup> solid or

1 x 2.5 mm<sup>2</sup> stranded ferruled

Insulation of wires

or sleeve length: 8 mm

Plugin with cage clamp terminals max. cross section

for connection: 1 x 4 mm<sup>2</sup> solid or

1 x 2.5 mm<sup>2</sup> stranded ferruled

min. cross section for connection: 0.5 mm²

Insulation of wires

or sleeve length: 12  $^{\pm0.5}$  mm

Wire fixing: Plus-minus terminal screws M 3.5 box terminals with wire protection or

cage clamp terminals

Mounting: DIN rail IEC/EN 60 715

Weight: 220 g

## **Dimensions**

Width x height x depth

LG 5925/920: 22.5 x 90 x 121 mm LG 5925/920 PC: 22.5 x 111 x 121 mm LG 5925/920 PS: 22,5 x 104 x 121 mm

## Safety Related Data

# Values according to EN ISO 13849-1:

| Category:                              | 4          |                 |
|--|------------|-----------------|
| PL:                                    | е          |                 |
| MTTF <sub>d</sub> :                    | 176.2      | a (year)        |
| DC <sub>avg</sub> :                    | 99.0       | %               |
| d <sub>a</sub> :                       | 365        | d/a (days/year) |
| d <sub>op</sub> :<br>h <sub>op</sub> : | 24         | h/d (hours/day) |
| t <sub>zyklus</sub> :                  | 3600       | s/Zyklus        |
| Zynus                                  | <b>≙</b> 1 | /h (hour)       |

## Values according to IEC EN 62061 / IEC EN 61508:

| SIL CL:                    | 3        | IEC EN 62061    |
|----------------------------|----------|-----------------|
| SIL                        | 3        | IEC EN 61508    |
| HFT*):                     | 1        |                 |
| DC <sub>avg</sub> :<br>SFF | 99.0     | %               |
| SFF                        | 99.7     | %               |
| PFH <sub>D</sub> :         | 2.66E-10 | h <sup>-1</sup> |
| T,:                        | 20       | a (year)        |

\*) HFT = Hardware-Failure Tolerance



The values stated above are valid for the standard type. Safety data for other variants are available on request.

The safety relevant data of the complete system has to be determined by the manufacturer of the system.

#### **Standard Type**


LG 5925.48/920 DC 24 V

Article number: 0063683

Output: 3 Schließer, 1 Öffner

Nominal voltage  $U_N$ : DC 24 V Width: 22.5 mm

## **Ordering Example**

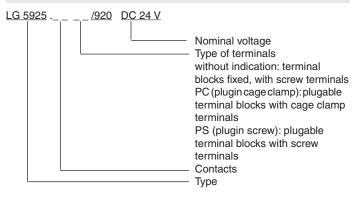

## **Options with Pluggable Terminal Blocks**






Screw terminal (PS/plugin screw)

Cage clamp terminal (PC/plugin cage clamp)

#### Notes


Removing the terminal blocks with cage clamp terminals

- 1. The unit has to be disconnected.
- 2. Insert a screwdriver in the side recess of the front plate.
- 3. Turn the screwdriver to the right and left.
- Please note that the terminal blocks have to be mounted on the belonging plug in terminations.




3 14.03.14 en / 425





safe breaking, no continuous arcing, max. 1 switching cycle/s

## Arc limit curve under resistive load

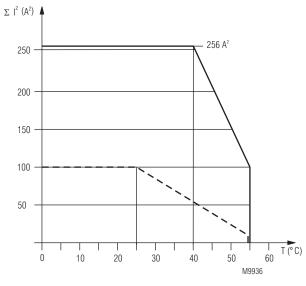

device mounted on distance with air circulation. max. current at  $55^{\circ}$ C over  $4 \text{ contactrows} = 5A \cong 4x5^{2}A^{2} = 100A^{2}$ 

device mounted without distance heated by devices with same load, max current at  $55^{\circ}\text{C}$  over  $4 \text{ contactrows} = 1\text{A} \cong 4\text{x1}^2\text{A}^2 = 4\text{A}^2$ 

$$\Sigma \; I^2 \! = I_1^2 + I_2^2 + I_3^2 + I_4^2$$

 $\boldsymbol{l}_1, \, \boldsymbol{l}_2, \, \boldsymbol{l}_3, \, \boldsymbol{l}_4$  - current in contactrows

# Quadratic total current limit curve

## Accessories




NE 5020.92 safety switch, magnetic coded, for DC 24 V, with 2 semiconductor outputs



NE 5021.02 safety switch, magnetic coded, with 2 NO contacts (reed contacts)

4 14.03.14 en / 425

# **Application Examples**

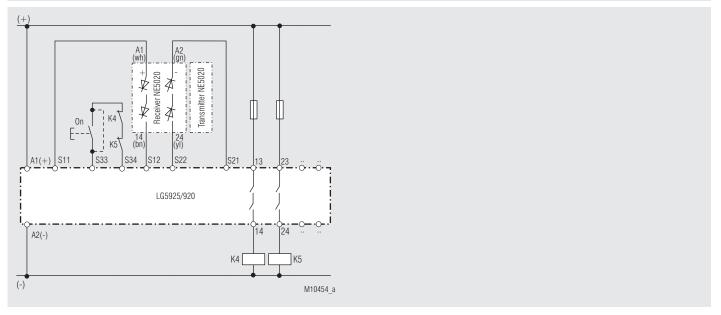


With safety switch NE 5020. Contact reinforcement by external contactors. 2-channel operation, cross fault detection

# Please note: Refer to "Unit programming"!

Switches in position: S1 cross fault detection

S2 manual start

With autostart link On-button and set S2 to "automatic". Suited up to SIL3, Performance Level e, Cat. 4

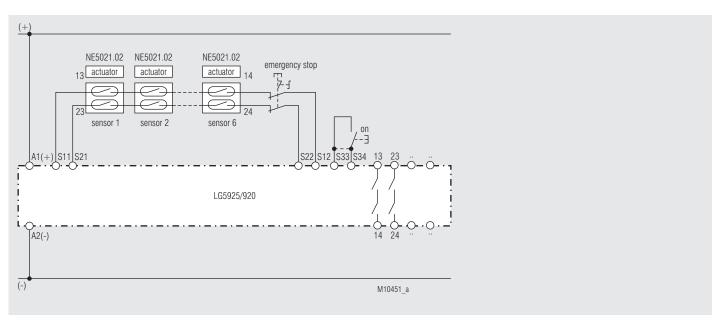

5

6 safety switches NE 5021 + 1 E-stop button in series. 2-channel operation, cross fault detection

# Please note: Refer to "Unit programming"!

Switches in position: S1 cross fault detection

S2 manual start

With autostart link On-button and set S2 to "automatic".

Suited up to SIL3, Performance Level e, Cat. 3

14.03.14 en / 425

| E. DOLD & SÖHNE KG • D-78114 Furtwangen • | PO Box 1251 • Telephone (+49) 77 23 / 654-0 • Telefax (+49) 77 23 / 654-356 |
|---|---|